

Heating safely with gas-fired infrared heaters


**FROM THE
INFRARED HEATER
SAFETY COUNCIL**



irsafetycouncil.org



Patio Heaters

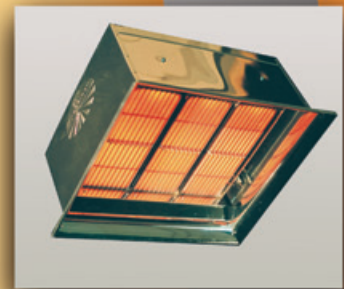


High Intensity Ceramic Heaters



Low Intensity Tube Heaters



Construction Heaters

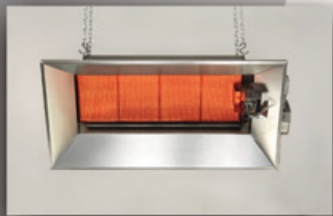

High Intensity Ceramic Heater



Low Intensity Tube Heater



Construction Heater



Patio Heater

WHAT IS A GAS-FIRED, INFRARED HEATER?

There are several types of gas-fired, infrared heaters, such as ceramic heaters, tube heaters and patio heaters. These heaters use a burner containing gas combustion controls, a heat exchanger element and reflectors.

CLEAN, QUIET AND EFFICIENT HEATING

There are many benefits to using gas-fired, infrared heaters. Just as the sun heats the earth, infrared heaters heat people and objects directly. Warmed objects in turn create a heat sink which allows for **quick heat recovery and greater comfort** at lower air temperatures. The result is proven **lower fuel and electricity costs**.

Unlike air heaters, infrared heaters do not blow dirt and dust, helping to provide **quiet and clean comfort**. They are easy to install as well as maintain; and with the many models on the market today, infrared heaters offer **design flexibility** to fit a variety of floor plans and building types.

REFER TO THE IRSC FOR CURRENT, ACCURATE INFORMATION

The Infrared Heater Safety Council (IRSC) was created by gas-fired, infrared heating equipment manufacturers, to enhance user safety through education of building inspectors, fire authorities and end users on safe practices.

Infrared heating technology has a long history of safety and has been widely used in a variety of commercial and industrial applications such as warehouses, manufacturing facilities, fire stations, vehicle service facilities and aircraft hangars. Like all gas burning products, infrared heaters have installation, operation and service procedures that must be followed to ensure safety.

Note: While this brochure covers basic concepts, it does not replace manufacturers' Installation, Operation and Service manuals. Read the instructions and follow them. The IRSC recommends that all installation, service and annual inspection work be done by a qualified person or agency.

WHY BUILDING OWNERS CHOOSE INFRARED HEATING ...

- Average 30% fuel savings over conventional heating methods.
- Heating the floor level, not the ceiling, provides superior comfort.
- Flexible heater placement allows heat concentration where it is needed most.
- Infrared heaters are durable and can be easily maintained and cleaned.
- Infrared heaters do not push dirt and dust around resulting in a quiet and clean environment.



PROPER USE

Infrared heaters are designed to provide warmth and comfort for commercial, industrial and some approved residential applications. Most infrared heaters* are **not** approved for:


- Residential indoor living or sleeping areas.
- Process heating, such as paint booths, grain bins, material drying.
- Hazardous (class 1 or 2) environments.

* Only applies to infrared heaters certified to ANSI Standards Z83.20 [Low Intensity], Z83.19 [High Intensity], Z83.7 [Construction] or CSA Standard 5.90 [Patio Heaters]

WARNING



Apply infrared heaters only as allowed by the manufacturer or as set forth by National, State or Local Codes.

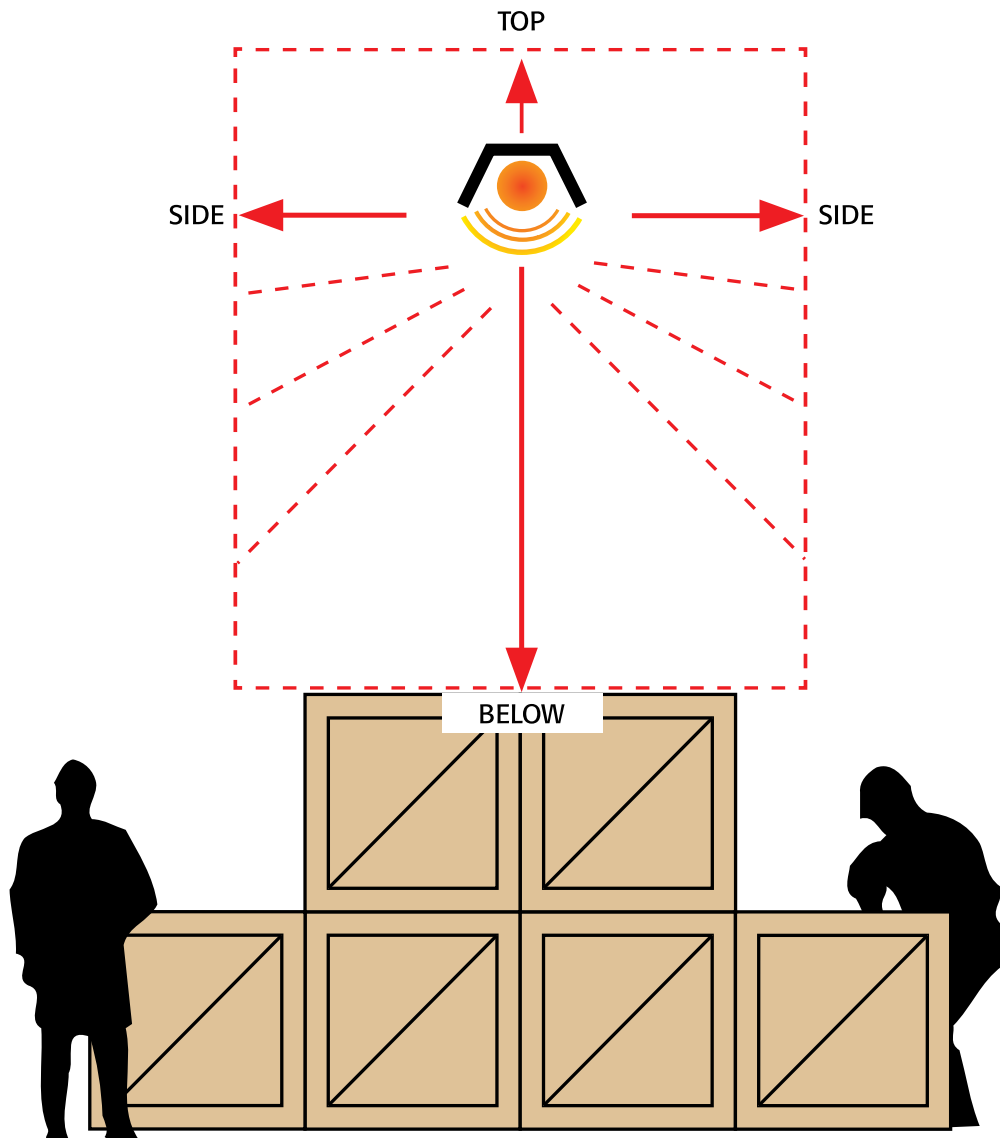

CLEARANCES TO COMBUSTIBLES

RESPONSIBILITY OF THE INSTALLERS AND USERS




Ensure that building materials with a low heat tolerance are protected to prevent degradation.

"...in locations used for storage of combustible materials, signs shall be posted to specify the maximum permissible stacking height to maintain the required clearances from the heater to the combustibles."

This is quoted from the *National Fuel Gas Code* (ANSI Z223.1), and the *Standard for Gas-Fired Low-Intensity Infrared Heaters* (ANSI Z83.20).

ANSI Z83.20 further states "and that such signs must either be posted adjacent to the heater thermostats or in the absence of such thermostat in a conspicuous location."

CLEARANCES TO COMBUSTIBLES SAFETY ISSUES

 WARNING	
	
Fire Hazard	Explosion Hazard
Some objects will catch fire or explode when placed close to heater.	
Keep all flammable objects, liquids and vapors the required distance away from the heater.	
Failure to follow these instructions can result in death, injury or property damage.	

Clearances are the required minimum distances that combustible objects can be placed from the heater to prevent fire hazards. Combustibles are materials which may catch on fire and include common items such as wood, paper, rubber and fabric. Clearances to combustibles must be maintained at all times to ensure safety.

Even if equipment is installed with the proper clearances to combustibles, some materials may be present that have lower heat tolerances and may be subjected to degradation.

All infrared heaters shall have the clearances to combustibles prominently displayed on the product, as well as in the Installation, Operation and Service manual.

Read, understand and **follow** the safety guidelines below:

- Keep gasoline or other combustible materials including flammable objects, liquids, dust or vapors away from the heater or any other appliance.
- Maintain clearances from heat sensitive material, equipment and workstations.

- Maintain clearances from heat sensing devices, such as sprinkler systems, and make sure these devices are not overheated.
- Maintain clearances from vehicles parked below the heater.
- Maintain clearances from swinging and overhead doors, overhead cranes, vehicle lifts, partitions, storage racks, hoists, building construction, etc.
- Hang heater in accordance with the suspension requirements.
- Do not run gas pipe or conduit in the area of exhaust discharge of flue products or in the clearance zone.

WHEN BUILDING OWNERSHIP CHANGES


It is imperative that current and future building owners are well informed regarding the infrared heating system in their building. If the building is sold to a new owner, it is the responsibility of the seller to transfer all documentation of the heating system, including the Installation, Operation and Service manual to the new owner. Placards should be properly placed and/or relocated. Contact the factory for additional copies of the Installation, Operation and Service manual.

CHANGE TO BUILDING CONSTRUCTION AND/OR HEATING SYSTEM

Special consideration is required if:

- Building has been remodeled or renovated since the last inspection.
- Additional heaters have been added.
- Equipment has not been operated for an extended period of time.
- Usage of the building has changed.
- User has questions or concerns about the operation of the equipment.


PROPER GAS CONNECTION

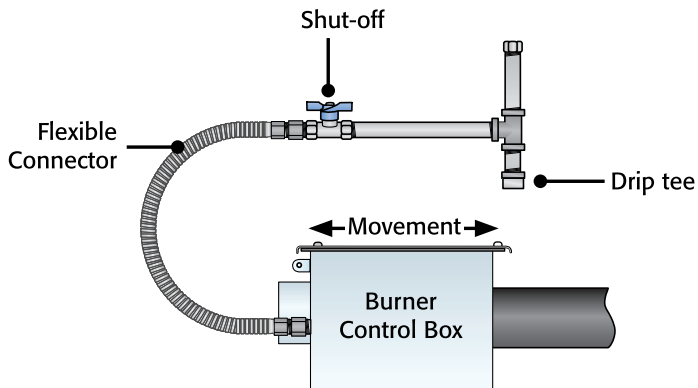

Connect heater to gas supply using the proper equipment as set forth by ANSI, NFPA and the manufacturer. Consult manual for instructions on pressure, expansion and other safety requirements; including local codes.



IMPROPER GAS CONNECTION

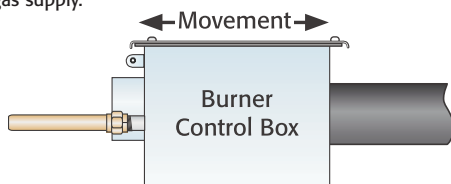Do not directly connect gas supply line to heater inlet. **Do not** use copper piping to connect unit to the gas supply.





Failure to properly connect the gas supply to the unit may result in leaks, improper heater operation and possible system failure including explosion or fire.

PROPER GAS CONNECTION

⚠ WARNING	
	
Fire Hazard	Explosion Hazard
<p>Tighten gas connector fittings to connect gas supply.</p> <p>Gas connector moves during normal operation.</p> <p>Failure to follow these instructions can result in death, injury or property damage.</p>	

When connecting an infrared heater to the supply line, allowances for heater expansion are required. A flexible gas connector of approved type must be used. The gas piping system shall not bear any weight of any appliance. See NFPA 54/ANSI Z223.1 National Fuel Gas Code, latest revision.

GAS CONVERSION

⚠ WARNING	
	
Carbon Monoxide Hazard	Fire Hazard
<p>Install heater with proper ventilation per installation instructions.</p> <p>Failure to follow these instructions can result in death, injury or property damage.</p>	

Gas conversions must be done by a qualified person or agency following the manufacturer's conversion instructions. Contact the manufacturer for proper instructions and parts.

PROPER VENTILATION

Heaters must be vented per all applicable codes.

All infrared heating manufacturers provide a variety of vent terminations and piping. For specific ventilation requirements, reference the manufacturer's Installation, Operation and Service manual.


Where unvented infrared heaters are used, natural or mechanical means shall be provided to supply and exhaust at least 4 cfm/1000 Btu/h of input of installed heaters.

CAREFULLY FOLLOW ALL VENTILATION INSTRUCTIONS!

- ✓ Provide proper fire guarding (thimbles, flashing, etc.) when venting through a combustible wall.
- ✓ Provide mechanical or natural ventilation of 4 cfm/1000 Btu/h of input when operating unvented.
- ✓ Provide fresh air for combustion when operating in harsh environments.
- ✓ Use a single control when common venting.
- ✓ Provide adequate separation from heater exhaust to air intake.
- ✓ Verify vent line(s) are free of obstructions and debris.


Consult manual for specific installation guidelines as each application may vary.

ROOFTOP VENTING REQUIREMENTS

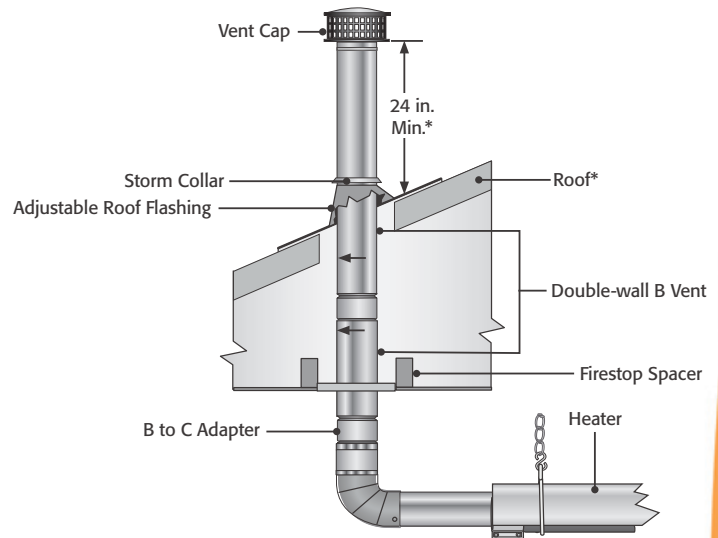

*Consult the NFPA ANSI Z223.1 Gas Vent Termination criteria if roof pitch exceeds 9:12

SIDEWALL VENTING REQUIREMENTS

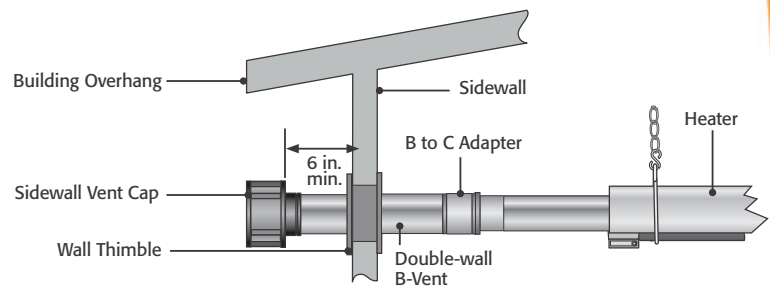

SAFETY INSPECTION CHECKLIST

For optimum performance and safety, the IRSC recommends that all installation, service and annual inspection be done by a qualified person or agency. This is not a comprehensive list. For a complete checklist, reference the Installation, Operation and Service Manual.

Make sure that:

- ☒ Clearances to combustibles warning signs must be posted as indicated on page 4.
- ☒ The manufacturer's Installation, Operation and Service Manual is legible. Keep manual in a clean, dry place. Contact the manufacturer for replacement labels or manuals.
- ☒ All warning labels are attached and legible.
- ☒ The area around the heater is free of combustibles.
- ☒ Reflector is in good condition and free of dust and debris. Clean outside surface with a damp cloth, if needed. Reflector must be properly resting on mounting brackets and not the tube itself.
- ☒ Vent pipe and outside air inlet are free of dirt, obstructions, cracks, gaps in the sealed areas or corrosion. Look for bird or insect nests. Remove any carbon deposits.
- ☒ Tubes are connected and suspended securely. There should be no holes, cracks or distortion on any part of the tube, especially the top.
- ☒ Gas line has no gas leaks. Check gas connection; See Proper Gas Connection in this brochure and refer to the the manufacturer's Installation, Operation and Service Manual.
- ☒ Combustion chamber and burner observation windows are clean and free of cracks or holes.
- ☒ Blower scroll wheel and motor are clean.
- ☒ Burner and orifice are clean.
- ☒ Igniter and electrode are not cracked, broken, eroded or showing signs of wear. Replace as needed.
- ☒ Thermostats, sensors and control devices have no exposed wire nor damage to the device or its wiring. Verify that clearance to combustible placecards are posted.
- ☒ Suspension of the heater is secure. Look for signs of wear on the chain or ceiling.
- ☒ Pump and blower inlets and outlets are free of blockage or soot.
- ☒ Ceramic tiles in burner assembly are not operating in a flashback condition (burning behind grids).
- ☒ Ceramic tiles are not cracked. Ceramic burner assembly gaskets must be in place. Do not clean with high pressure air.

APPLICABLE STANDARDS AND CODES

Installation must comply with national and local codes and requirements of the local gas company.

GAS CODES

United States: Refer to National Fuel Gas Code, ANSI Z223.1 – latest revision (same as NFPA 54). Canada: Refer to CAN/CSA-B149.1 Natural Gas and Propane Installation Code.

AIRCRAFT HANGARS

United States: Refer to Standard for Aircraft Hangars, ANSI/NFPA 409 – latest revision.

Canada: Refer to CAN/CSA-B149.1 Natural Gas and Propane Installation Code.

PUBLIC GARAGES

United States: Standard for Parking Structures NFPA 88A – latest revision or the Code for Motor Fuel Dispensing Facilities and Repair Garages, NFPA 30A – latest revision. Canada: Refer to CAN/CSA-B149.1 Natural Gas and Propane Installation Code.

ELECTRICAL

United States: Refer to National Electrical Code®, ANSI/NFPA 70 – latest revision. Canada: Refer to Canadian Electrical Code, CSA C22.1 Part 1 – latest revision.

VENTING

The venting must be installed in accordance with the units Installation, Operation and Service Manual and the following codes. United States: Refer to NFPA 54/ANSI Z223.1 – latest revision, National Fuel Gas Code. Canada: Refer to CAN/CSA-B149.1 Natural Gas and Propane Installation Code.

ADDITIONAL CONSIDERATIONS

SIGNAGE REQUIREMENTS

- In locations used for storing combustible materials, signs must be posted to specify the maximum permissible stacking height to maintain the required clearances from the heater to the combustibles.
- Signs must be posted adjacent to the heater thermostat. In the absence of a thermostat, signs must be posted in a conspicuous location.

LOCATION OF EQUIPMENT

Infrared heaters must be installed by a qualified person or agency per applicable codes and the manufacturer's Installation, Operation and Service manuals. Installers are also responsible for the following:


- To install the heater in accordance with the clearances to combustibles.
- To provide access for servicing.
- To give a copy of the manufacturer's Installation, Operation and Service manual to the owner.
- To ensure there is adequate air circulation around the heater.
- To ensure the heater is placed in an approved application.

TYPE OF FUEL


The type of gas appearing on the heater's nameplate must be the type of gas used.



Patio Heaters

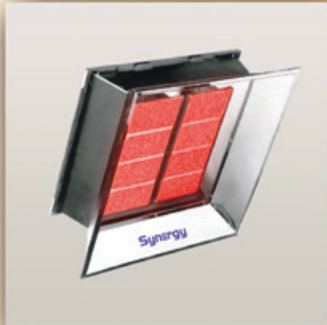

High Intensity Ceramic Heaters

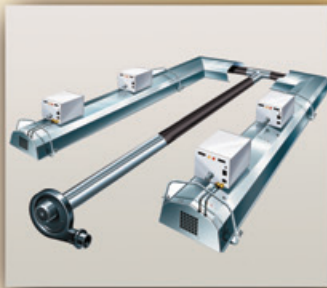

Low Intensity Tube Heaters



Construction Heaters

INFRARED HEATER TYPES

Patio Heaters:

Sometimes referred to as – suspended, radiant, mushroom style, free standing or decorative patio heaters.

- Ceramic or stainless steel radiant emitters.
- Designed to heat a concentrated outdoor area.
- Permanent or portable products that may be deck mounted or suspended.

High Intensity Ceramic Heaters:

Sometimes referred to as – box heaters, unvented heaters, spot heaters, luminous heaters, radiant heaters or plaque heaters.

- Combustion takes place on a ceramic tile surface with surface temperatures of approximately 1800°F. Higher temperatures (hence, “high-intensity”) result in higher clearance to combustibles.
- Direct fired operation releases products of combustion into a properly ventilated heated space.
- Often used in high bay or high air change applications.

Low Intensity Tube Heaters:

Sometimes referred to as – positive/negative pressure heaters, tube heaters, radiant heaters, stick heaters, tube brooders or pipe heaters.

- Hot exhaust gases travel through the inside of the tube resulting in tube surface temperatures commonly in the 800-1100°F temperature range (hence, “low-intensity”).
- Can be vented and commonly has the capability to use fresh air for combustion.
- The most popular choice for total building heat.

Construction Heaters:

Sometimes referred to as – salamanders, spot heaters, portable construction heaters and tank top heaters.

- Heat turns a ceramic or stainless steel emitter red hot.
- Used in spot heat applications and/or as warm up stations.
- Units may be used in industrial applications or as temporary heat inside buildings under construction or repair. At no time shall construction heaters be used in residential applications.



Ambi-Rad Limited
12910 Ford Dr.
Fishers, IN 46038
Phone: 888.330.4878
www.ambirad.com



Combustion Research Corp.
2516 Leach Rd.
Rochester Hills, MI 48309-3555
Phone: 888.852.3611
www.combustionresearch.com



DESA Heating, LLC
2701 Industrial Dr.
Bowling Green, KY 42101
Phone: 270.781.9600
www.desaint.com



Detroit Radiant Products Company
21400 Hoover Rd.
Warren, MI 48089 USA
Phone: 586.756.0950
www.detroitradiant.com



Enerco Technical Products
4560 W. 160th St.
Cleveland, OH 44135
Phone: 800.251.0001
www.enerco.com



SPACE-RAY



Gas Fired Products, Inc.
P.O. Box 36485
Charlotte, NC 28236-6485
Phone: 800.830.3983
www.gasfiredproducts.com



Infrared Dynamics, Inc.
3830 Prospect Ave.
Yorba Linda, CA 92886
Phone: 888.317.5255
www.infradyne.com



Modine
Commercial Products Group
Modine Manufacturing Company
1500 DeKoven Ave.
Racine, WI 53403-2552
Phone: 800.828.4328 (HEAT)
www.modine.com



Roberts-Gordon, LLC
1250 William St., P.O. Box 44
Buffalo, NY 14240-0044
Phone: 800.828.7450
www.rg-inc.com



Schwank North America
5285 Bradco Blvd.
Mississauga, ON L4W 2A6 Canada
Phone 905.712.4766 (Canada)
Phone 706.554.6191 (U.S.A.)
www.schwankgroup.com



Solarflo Corporation
22901 Aurora Rd., P.O. Box 46391
Bedford Heights, OH 44146
Phone: 800.626.9572
www.solarflo.com



Superior Radiant Products Ltd.
428 Millen Road, Unit 23
Stoney Creek, ON L8E 3N9 Canada
Phone: 800.527.HEAT (4328)
www.superiorradiant.com



Infrared Heater Safety Council
2107 Wilson Boulevard
Suite 600
Arlington, VA 22201

irsafetycouncil.org

PRESORTED
FIRST CLASS
U.S. POSTAGE
PAID
MAILED FROM
ZIP CODE 60477
PERMIT #222

Are you using
infrared heaters safely?



©2008 Infrared Heater Safety Council

Heating safely with gas-fired
infrared heaters

FROM THE INFRARED HEATER SAFETY COUNCIL

