

ELECTRICAL

The heater, when installed, must be electrically grounded in accordance with the Canadian Electrical Code C22.1 (latest edition).

Applications in Canada must conform to the Canadian Electrical Code C22.1 (latest edition) when an external electrical source is used.


Applications in United States must conform to the National Electrical Code ANSI/NFPA 70 (latest edition).

Refer to rating label on heater for the required amperage rating.

Under no circumstance is the electrical supply line to the heater to provide any assistance in the suspension of the heater.

Neither the electrical supply line nor sprinkler heads shall be located within the minimum clearances to combustibles.

**TYPICAL 120 volt INSTALLATION FOR
SINGLE LINE BREAK THERMOSTAT
Single Phase**

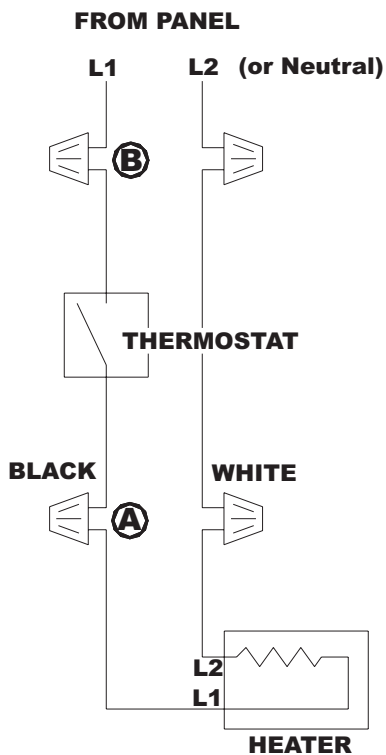

**TYPICAL 240, 208 volt INSTALLATION FOR
DOUBLE LINE BREAK THERMOSTAT
Single Phase**

